


4

3

2

1

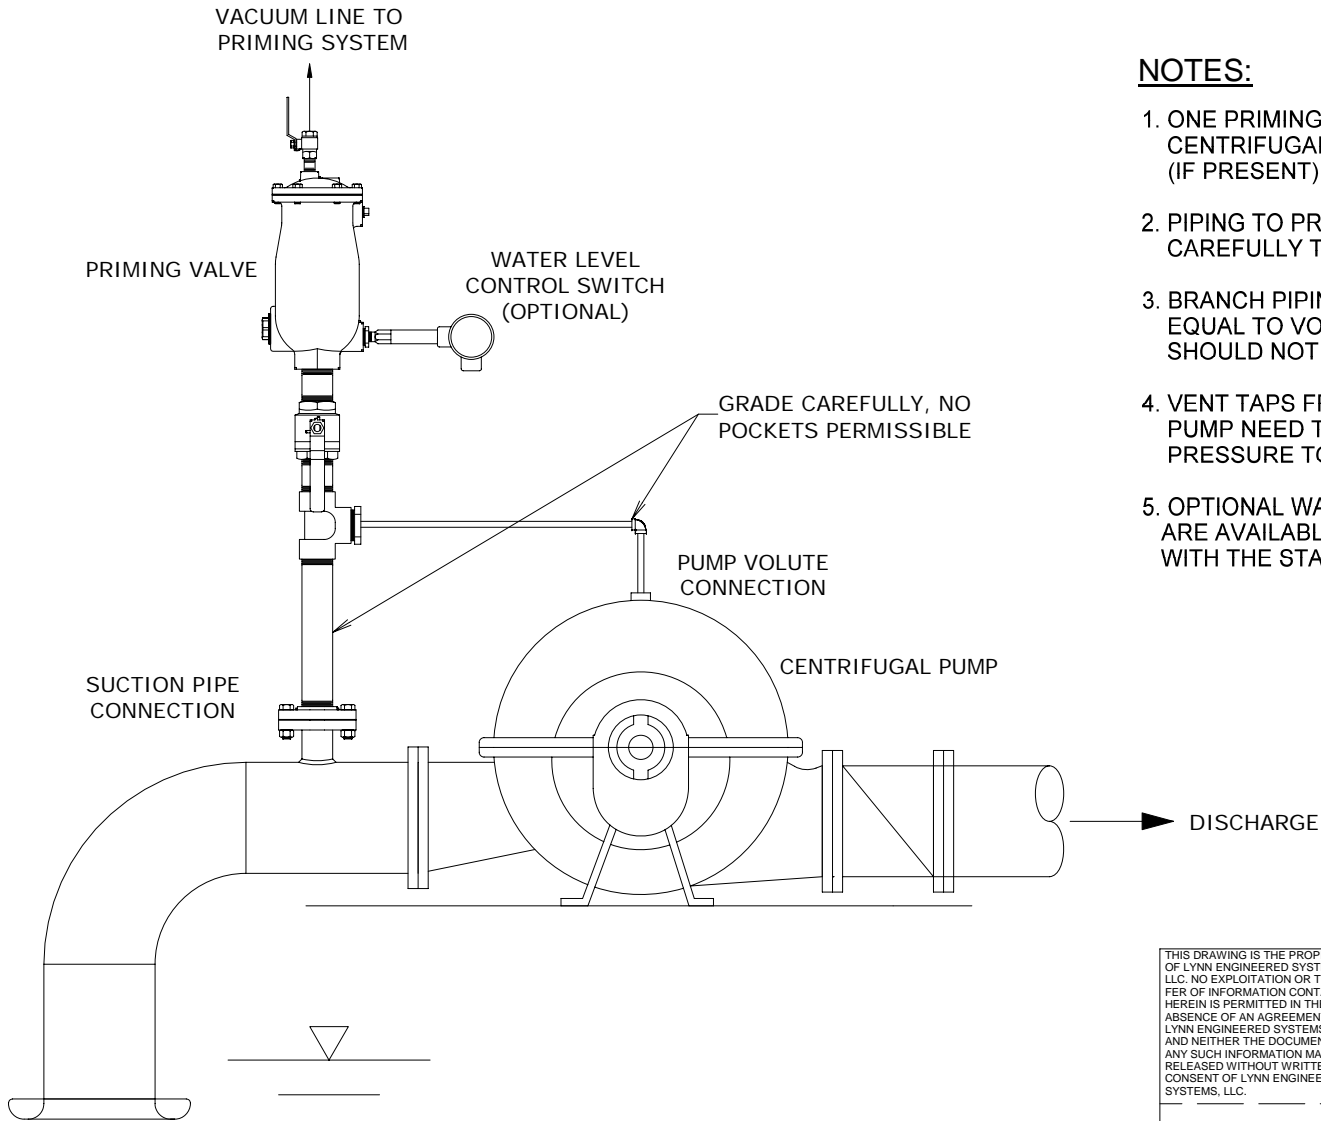

**NOTES:**

1. ONE PRIMING VALVE REQUIRED FOR EACH CENTRIFUGAL PUMP AND AT ANY HIGH POINT (IF PRESENT) IN THE SUCTION PIPING.
2. PIPING TO PRIMING VALVE MUST BE GRADED CAREFULLY TO AVOID ANY AIR POCKETS.
3. BRANCH PIPING TO PUMP VOLUTE SHOULD BE EQUAL TO VOLUTE VENT CONNECTION SIZE BUT SHOULD NOT EXCEEDING 1/2".
4. VENT TAPS FROM THE PRESSURE SIDE OF THE PUMP NEED TO INCLUDE ORIFICE TO REDUCE PRESSURE TO VALVE RATING.
5. OPTIONAL WATER LEVEL CONTROL SWITCHES ARE AVAILABLE FOR PROOF OF PRIME INTERLOCK WITH THE START-UP OF THE CENTRIFUGAL PUMP.

THIS DRAWING IS THE PROPERTY OF LYNN ENGINEERED SYSTEMS, LLC. NO EXPLOITATION OR TRANSFER OF INFORMATION CONTAINED HEREIN IS PERMITTED IN THE ABSENCE OF AN AGREEMENT WITH LYNN ENGINEERED SYSTEMS, LLC. AND NEITHER THE DOCUMENT NOR ANY SUCH INFORMATION MAY BE RELEASED WITHOUT WRITTEN CONSENT OF LYNN ENGINEERED SYSTEMS, LLC.				LYNN Engineered Systems, LLC 28835 N. Herky Dr., Lake Bluff, IL 60044	
TITLE TYPICAL PIPING ARRANGEMENT FOR PRIMING VALVE					
SIZE <b>B</b>	CAGE CODE	DWG NO <b>LES-2012</b>	REV		
SCALE NONE	SHEET		1/1		

4

3

2

1